

FRANKLIN – WALAWALA 1 (115kV)

As measured at FRANKLIN (12498)


LINE LOADINGS, 2003

Peak (pos) = 53.44 MW
15JUL03 18:40

MAX/MEAN/MIN BY DAY
2003, ALL HOURS

Peak (neg) = -85.44 MW
26APR03 04:35

Top of Line=Daily "Max" Circle=Daily "Mean" Bottom of Line=Daily "Min"

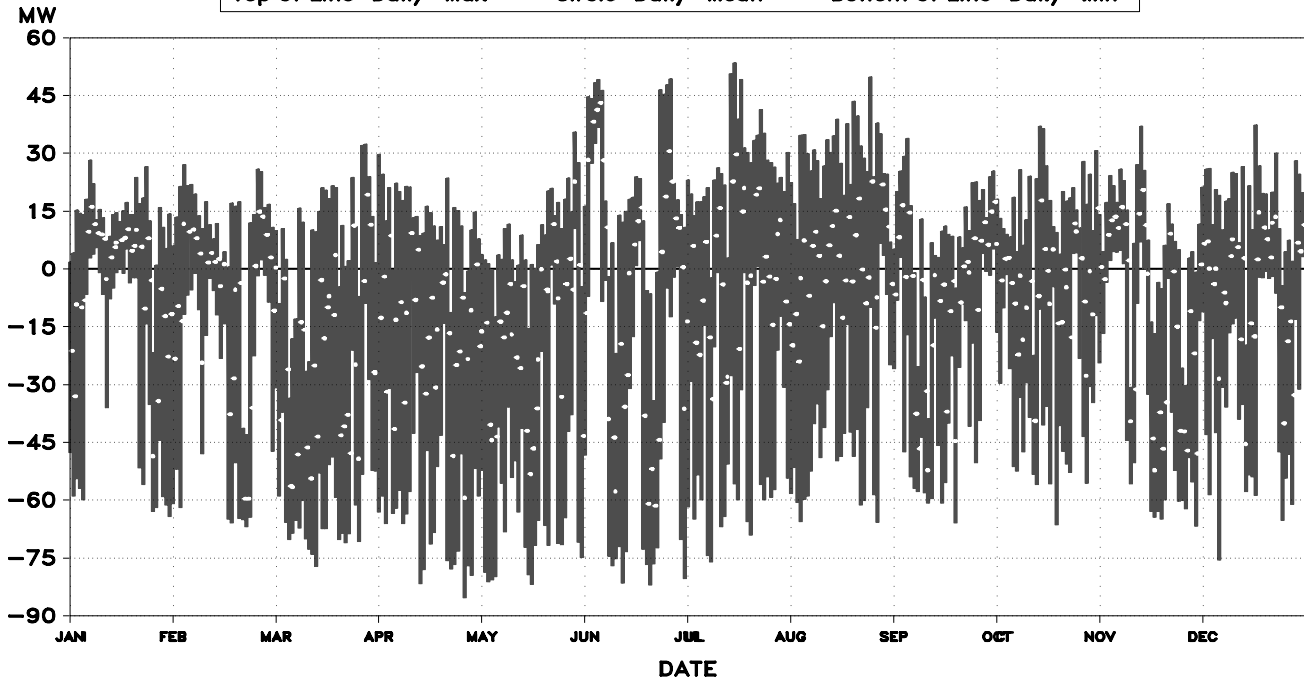


"Max/Mean/Min" designations based on algebraic values only (not directionality)

CUMULATIVE FREQUENCY DISTRIBUTIONS

2003, By Heavy – Load and Light – Load Hours

— 2003 HEAVY HRS - - 2003 LIGHT HRS

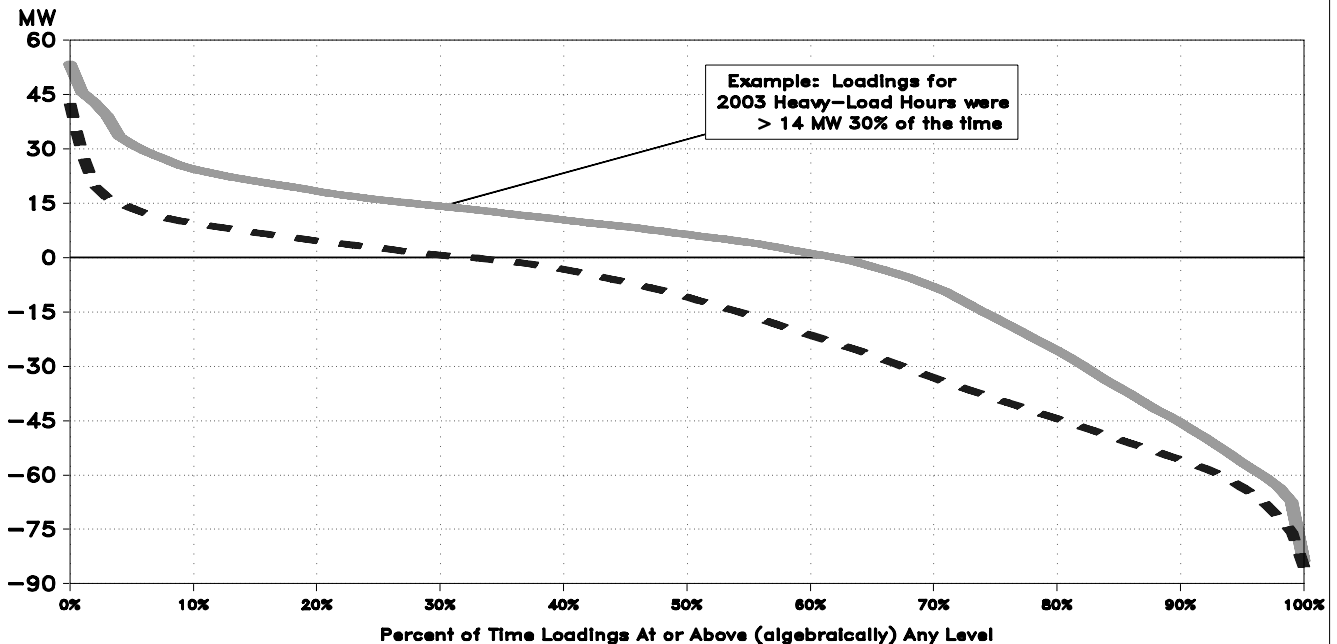

Light load hours = hours ending 23–06 and Sundays and holidays

Negative loadings are into FRANKLIN; positive loadings are out from FRANKLIN

Source: 5-minute readings via SCADA (analysis excludes recorded values between -5 and +5 MW)

Technical Operations (TOT) 26JAN04